


Ten top tips

to keep your gasketed plate heat exchanger in tip top condition

- 1 Make sure that the operating conditions (temperatures and flow rates) comply with the design specifications.
- 2 At start-up, vent the heat exchanger but open and close the valves slowly to avoid pressure surges and water hammer.
- 3 Use upstream filters and strainers to remove particulate fouling and protect the heat exchanger.
- 4 On a daily basis check for any changes in temperature or pressure and check for any signs of external leaks.
- 5 On a regular basis keep the tightening bolts clean and well-lubricated.
- 6 Use Performance Audit to avoid having to open the plate heat exchanger for inspection.
- 7 Use Cleaning-In-Place (CIP) to avoid the need to open the heat exchanger for cleaning.

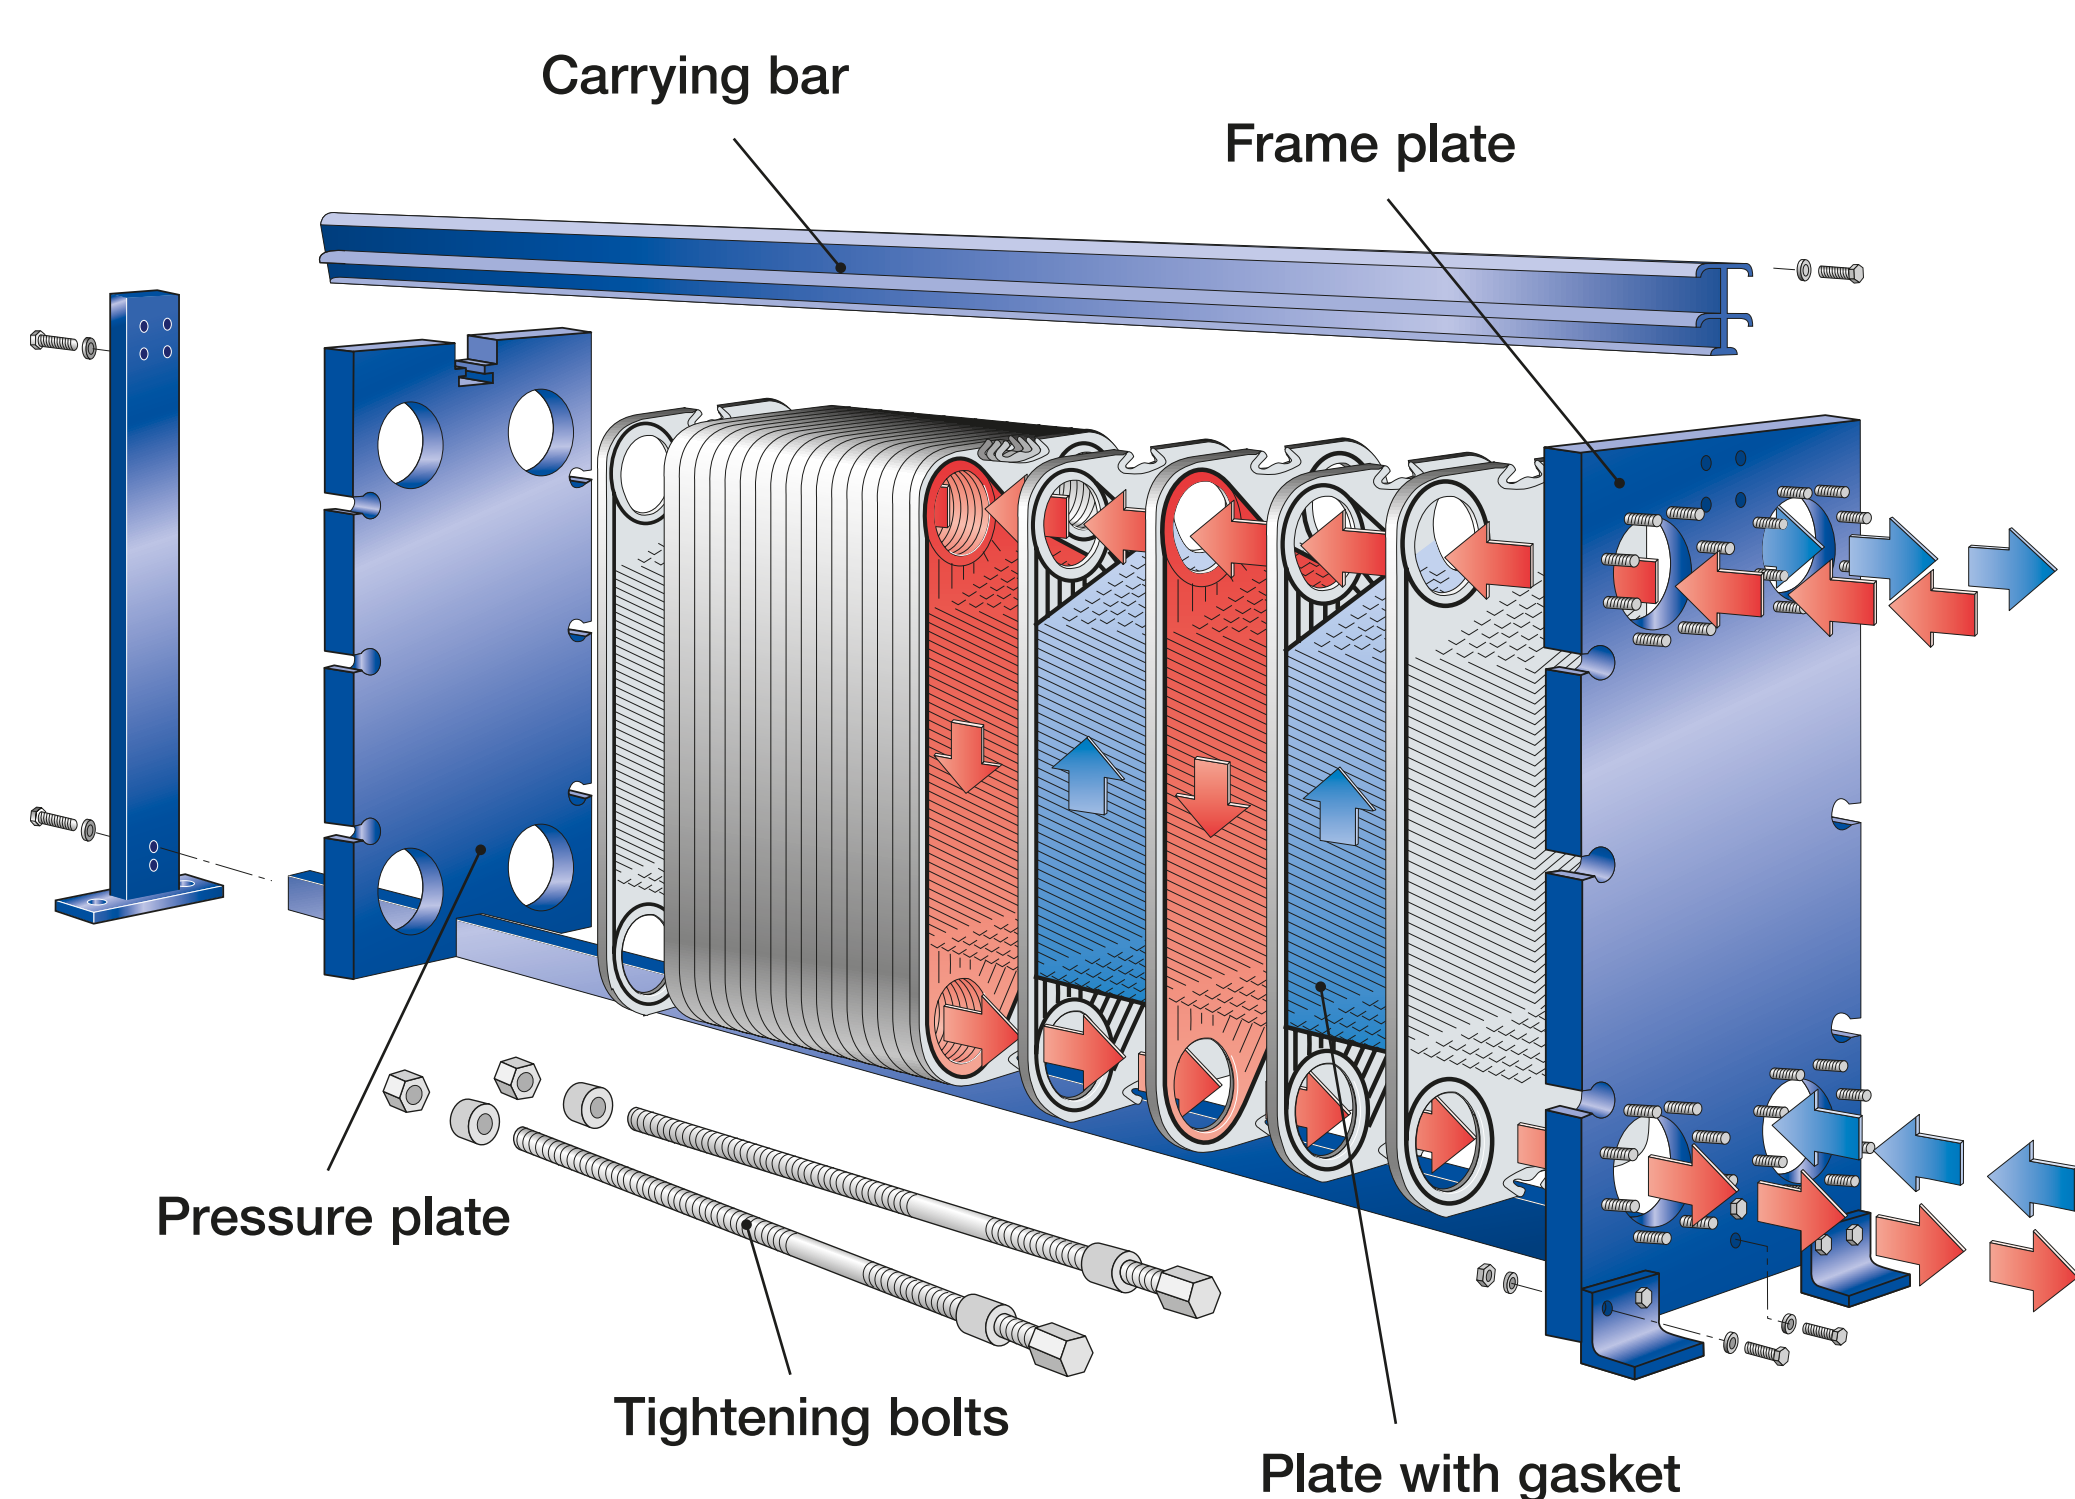

- 8 Always keep stand-by units clean and dry. If a heat exchanger is taken out of service, flush with fresh water and drain it completely.
- 9 Protect heat exchangers from water splash and rain. Avoid exposure to ultra violet rays and ozone typically generated from electrical sources.
- 10 Only use genuine spare parts for guaranteed performance, reliability and equipment life. Maintain a stock of essential spare parts and follow the storage instructions.

Alfa Laval Service
Extending Performance



www.alfalaval.com